
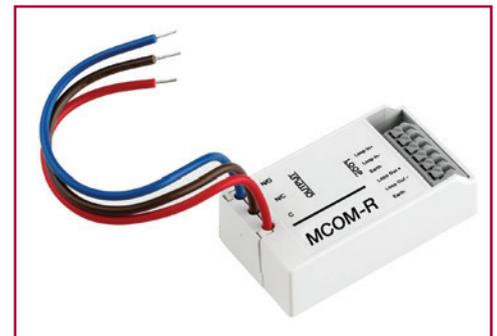


MCOM

Micro Single Channel Output Units

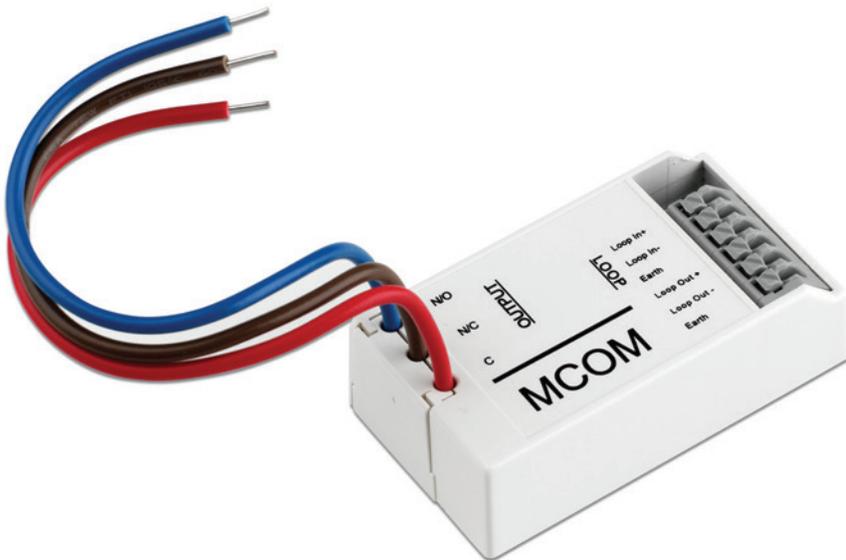

An extensive range of micro interfaces are available to support our range of control panels, providing solutions for most design requirements.

The MCOM is a single output, soft addressed, micro interface, incorporating integral short circuit isolators. It is extremely compact and therefore ideal for incorporation into other equipment.

The MCOM is fully compatible with the current range of Menvier intelligent addressable fire control panels.

It is suitable for switching low voltage (24V dc at 1A maximum), via a set of non latching relay contacts.

It is suitable for switching HVAC control circuits, plant shutdown control circuits, fire door closure etc.

Optional Variants

The (MCOM-R) gives a 5 second pulse on reset, and is used for connecting/resetting beam detectors.

The (MCOM-S) is identified by the panel as a sounder and does not reset when put into 'silence' mode, only resets once panel has been reset.


Benefits

- Quick and simple to install
- Compact size
- Soft Addressed
- Integral short circuit isolator
- Plug and play, no hard addressing required
- No external short circuit isolator required

Technical Specification

Code	MCOM
Description	Micro single channel output unit
Standards	EN54 Pt17 & Pt18
Specification	
Operating Voltage	18.5V dc to 30V dc
Quiescent Current	310µA
Output Relay	
Switching Voltage	24V dc to 30V dc
Contact Rating	1A
Switching Power	30 Watts
Environmental	
Operating temperature	-10°C to +60°C
Humidity (non condensing)	0 to 95% RH
Physical	
Construction	PC/ABS
Dimensions (H x W x D)	63mm x 35mm x 18.5mm
Weight	0.078kg
Compatibility	
Suitable for use with	Eaton Intelligent addressable fire systems
Recommended loop/cable type	Fire Tuff, FP200, MICC

Dimensions

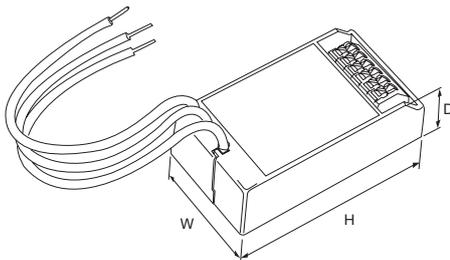


H (mm)	W (mm)	D (mm)
63	35	18.5

Installation


1. Suitable for switching 24V dc control circuits (fire door retainers etc).
2. Connections suitable for single strand fireproof cable up to 2.5mm².
3. Loop and output cable screen must be connected to interface earth terminals.
4. The relay output is a set of change over, non-latching, volt free contacts which are non monitored.

Note: No addressing of the interface is required (see control panel operation for details)

Mounting Details

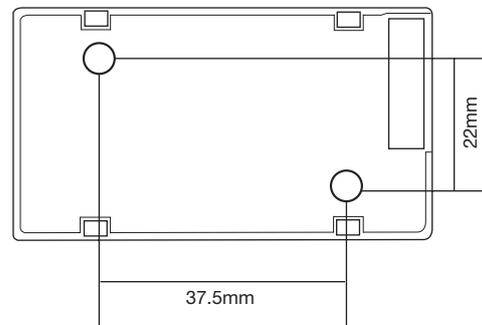

Standard Connections

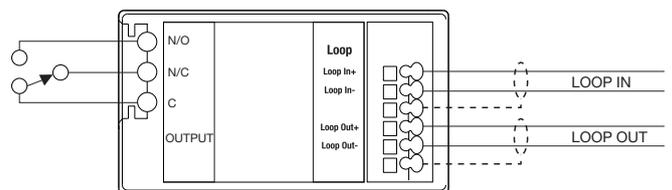

Catalogue numbers

Description	Code
Micro single channel output unit (recognised as output unit)	MCOM
Micro single channel output unit (recognised as sounder)	MCOM-S
Micro single channel output unit (5 second reset pulse)	MCOM-R
Mini module box unit (empty box)	ULBU